


P	I			500 VA									
ip			INTERPACT INS100	iC60N									
elicina			/	10A									
ostrojenje				-									
okalna				-									
abl-br.			-WE1+0BH03+0BH04; -WE2+0BH03+0BH04										
abl-fip			PP00 4x50 + PP00-Y 1x25										
ogon-br.			0.4kV Switchboard Return Return Water Collection Bund 0.4kV Razvodna tabla Prikupljanje Povratne Vode										

+0BH04

C		Ime/Name	Datum/Date	Ugovarač / Contractor	Naziv projekta / Project description	Investitor / Client	Projektant / Designer	Naziv crte za / Description	Jednopolna šema / Single Line Diagram					
B				Clyde Bergemann DRYCON Gosa Montaza	Zamena sistema za odlaganje pepela / Replacement of Ash Slurry System TE Kostolac A	Elektroprivreda Srbije	IKS	Knjiga / Volume : E 5	Broj priloga / Dwg.No.	List / Listova Page / Pages 1/2				
A											Korisnik / User	Institut "Kirilo Savić"	Svesk./Book : E 5.1.2	2.2
Ind	Revizija / Revision										TE Kostolac A			
	1	2	3	4	5	6	7	8						

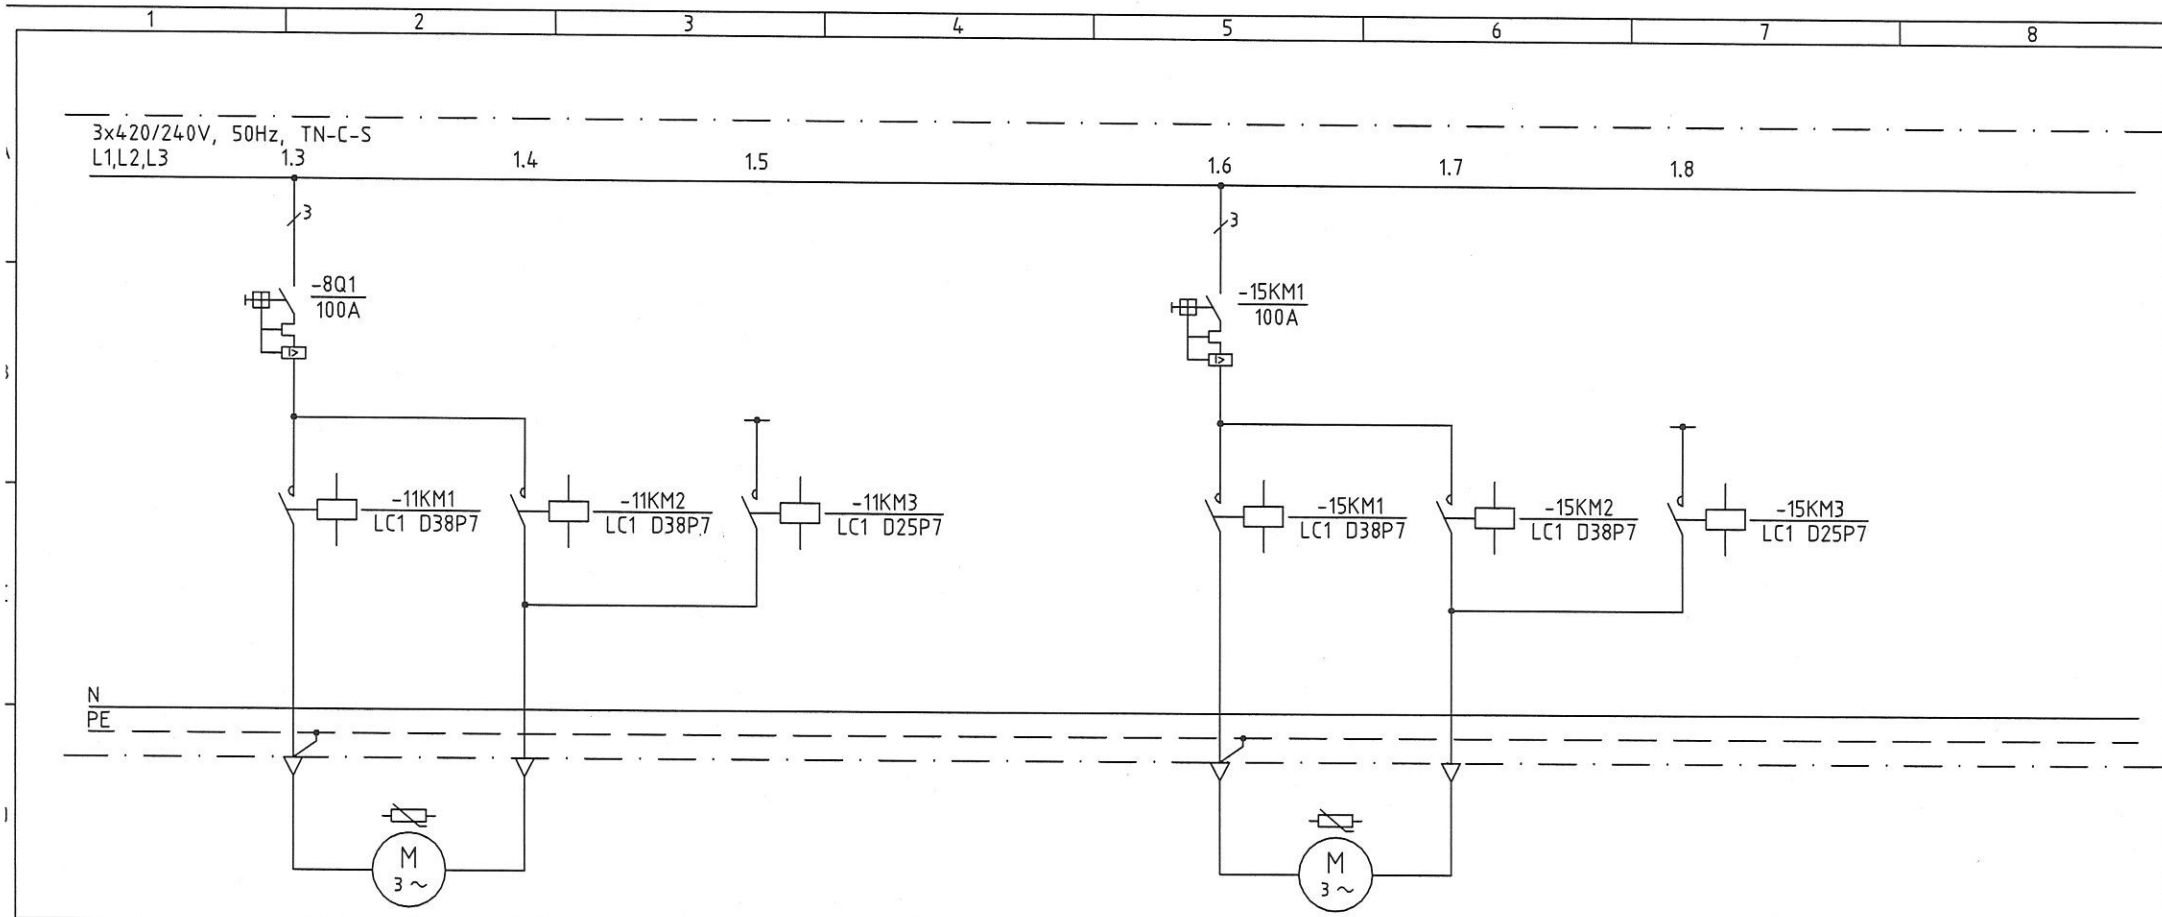


P	I	30 kW	62.3 A			30 kW	62.3 A		
Tip	COMPACT NSX100F					COMPACT NSX100F			
Velicina	Micrologic 2.2M					Micrologic 2.2M			
Polje	-					-			
Kaseta	-					-			
Kabl-br.	-WE1+0BH04+D001		-WE2+0BH04+D001			-WE1+0BH04+D002		-WE2+0BH04+D002	
Kabl-tip	PP00-Y 4x10		PP00-Y 4x10			PP00-Y 4x10		PP00-Y 4x10	
Pogon-br.	00TJ50D001-M01					00TJ50D002-M01			
	Return Water Discharge Pump No.1 Utopna Pumpa Sakupljanje Povratne Vode Br.1					Return Water Discharge Pump No.2 Utopna Pumpa Sakupljanje Povratne Vode Br.2			

+0BH04
/

C		Ime/Name	Datum/Date	Ugovarač / Contractor	Naziv projekta / Project description	Investitor / Client	Projektant / Designer	Naziv crteža / Description	Jednopolna šema / Single Line Diagram
B				Clyde Bergemann DRYCON Gosa Montaza	Zamena sistema za odlaganje pepela / Replacement of Ash Slurry System TE Kostolac A	Elektroprivreda Srbije	IKS	Knjiga / Volume : E 5 Svesk./Book : E5.1.2	Broj priloga / Dwg.No. 2.2
A			Korisnik / User						
Ind	Revizija / Revision					TE Kostolac A			

OPŠTI PODATCI O POSTROJENJU		
TIP	SLOBODNOSTOJEĆE FIKSNO EV-C1R0007	
VISINA	1200mm	
ŠIRINA	1200mm	
DUBINA	350mm	
DOVOD	DOLE	
KONEKCIJA	DOLE	
ENERGET.	FAZE	--
SABIRNICE	N/PF	--/--
In	100 A	
Iks	50 kA	
Un	400V	
f	50Hz	
temp.amb	35 °C	
IP	54	


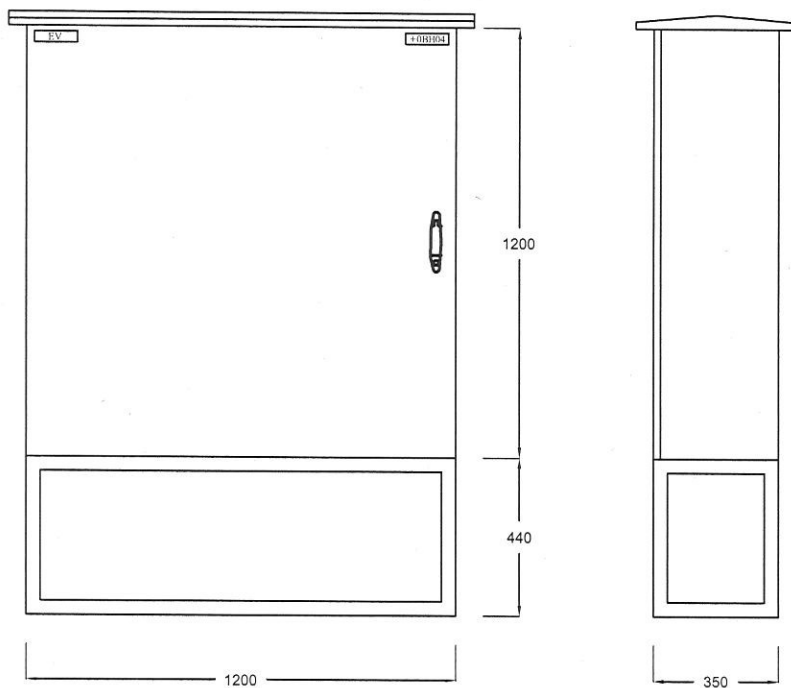


+0BH04
/

C		Ime/Name	Datum/Date	Ugovarač / Contractor	Naziv projekta / Project description	Investitor / Client	Projektant / Designer	Naziv crteža / Description	Prednji izgled + 0BH04 Front view + 0BH04
B				Clyde Bergemann DRYCON Gosa Montaza	Zamena sistema za odlaganje pepela / Replacement of Ash Slurry System TE Kostolac A	Elektroprivreda Srbije	IKS	Knjiga / Volume : E5 Svesk./Book : E5.1.2	Broj priloga / Dwg.No. 4.3
A						Korisnik / User			
Ind	Revizija / Revision					TE Kostolac A			

OPŠTI PODATCI O POSTROJENJU

TIP	SLOBODNOSTOJEĆE FIKSNO EV-C1R0007	
VISINA	1200mm	
ŠIRINA	1200mm	
DUBINA	350mm	
DOVOD	DOLE	
KONEKCIJA	DOLE	
ENERGET.	FAZE	--
SABIRNICE	N/PF	--/--
In	100 A	
Iks	50 kA	
Un	400V	
f	50Hz	
temp.amb	35 °C	
IP	54	

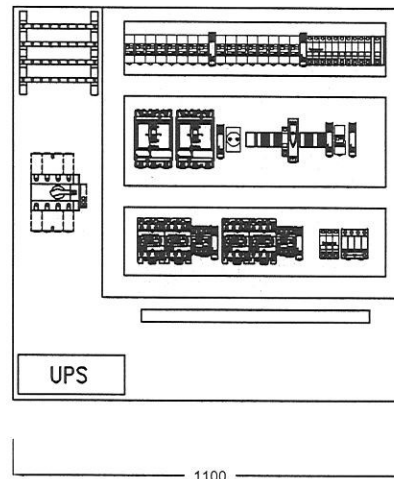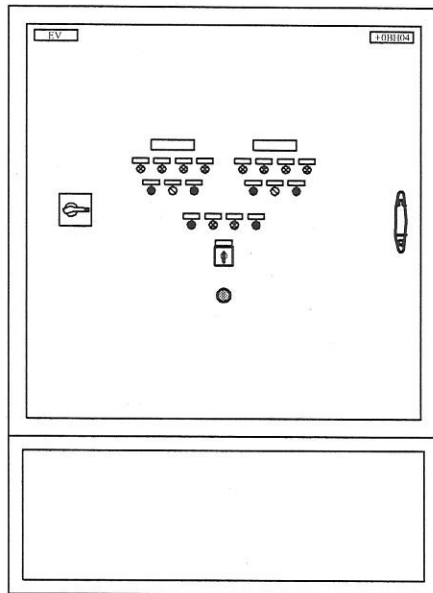

C		Ime/Name	Datum/Date	Ugovarač / Contractor	Naziv projekta / Project description	Investitor / Client	Projektant / Designer	Naziv crteža / Description	Dispozicija opreme +0BH04 Disposition of equipment +0BH04
B				Clyde Bergemann DRYCON Gosa Montaza	Zamena sistema za odlaganje pepela / Replacement of Ash Slurry System TE Kostolac A	Elektroprivreda Srbije		Knjiga / Volume : E5 Svesk./Book : E5.1.2	Broj priloga / Dwg.No. 4.4
A						Korisnik / User			
Ind	Revizija / Revision					TE Kostolac A			

+0BH04

/

1

2

3

4

5

6

7

8

1

2

3

4

5

6

7

8