

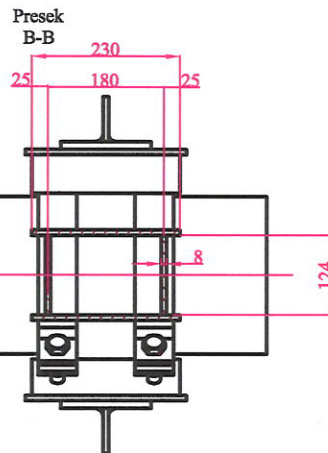
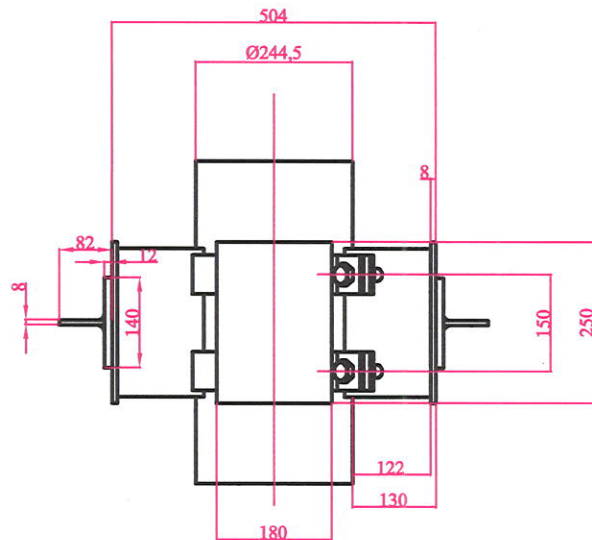
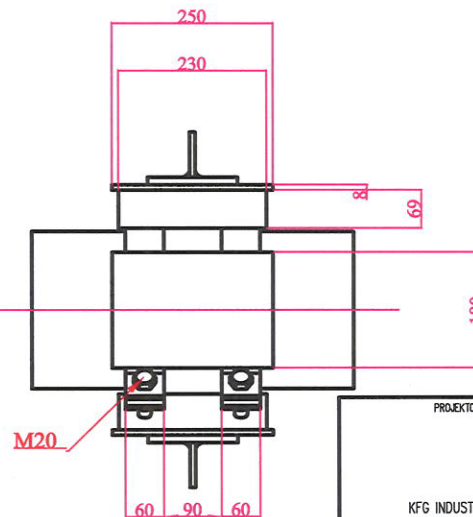


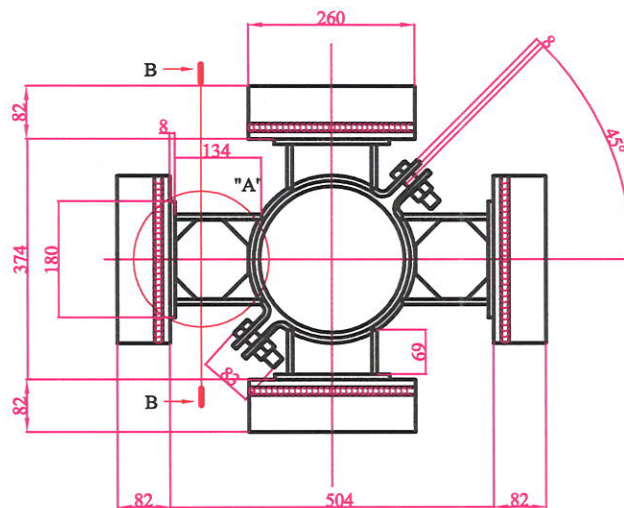

Detalj
"A"
Razmera
1:3

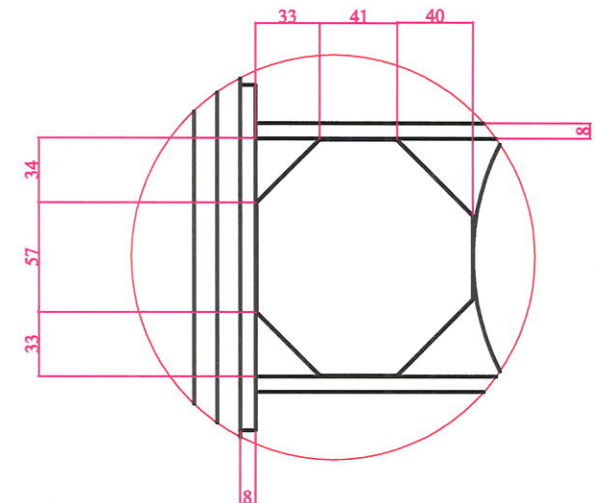

Vodeći oslonac VO-B

F_x , kN	F_y , kN	$+F_z$, kN	$-F_z$, kN	M_x , kNm	M_y , kNm	M_z , kNm
99	-	99	99	-	-	-

Napomena:

Crtež je informativnog karaktera. Isporučilac oslonca dostavlja detaljnu dokumentaciju u skladu sa rezultatima proračuna AKZ zaštita u klasi kao za cevovod.

PROJEKTOVANJE (ZVRŠIO)					
KFG INDUSTRIAL GROUP		Odgovorni projektant:		M.Ostojić	Potpis
		Projektant:		S.Genić	Datum
					09. 2012
CUSTOMER/NARUČILAC: ELECTRIC POWER INDUSTRY OF SERBIA					
DRAW/ CRTAO	DATE/DATUM	NAME/IME	SCALE/ RAZMERA		
CHECKED/ KONTROLISAO			1:8		
DESCRIPTION/NAZIV:			DRAWING INTERNAL No./BROJ INTERNOG CRTEŽA:		
REPLACEMENT OF ASH SLURRY SYSTEM KOSTOLAC A ZAMENA SISTEMA ODPEPELJIVANJA KOSTOLAC A GUIDE VO-B			U 055 06M 238		
VODEĆI OSLOMAC VO-B			DRAWING No./BROJ CRTEŽA: C062923638		
SHEET/LIST:				1 OD 1	REV:
CAD:				ACAD 2012	00



CLYDE BERSEMAN
LAWRENCE BOULEVARD
LAWRENCE
DONCASTER, SOUTH YORKSHIRE
S16 9PL, ENGLAND
Tel : +44 (0)1302 502200
Fax : +44 (0)1302 369005
www.cbm.co.uk

No reproduction or publication of this drawing may be made and no article may be manufactured or assembled in accordance with this drawing without prior written consent. Protected by U.K. Design Right under the terms of the copyright, design and patents act 1988.